


Arrangement for supplying load at 11 kV to Sitaram Bhartiya Hospital, B-16 Qutab Institutional Area.

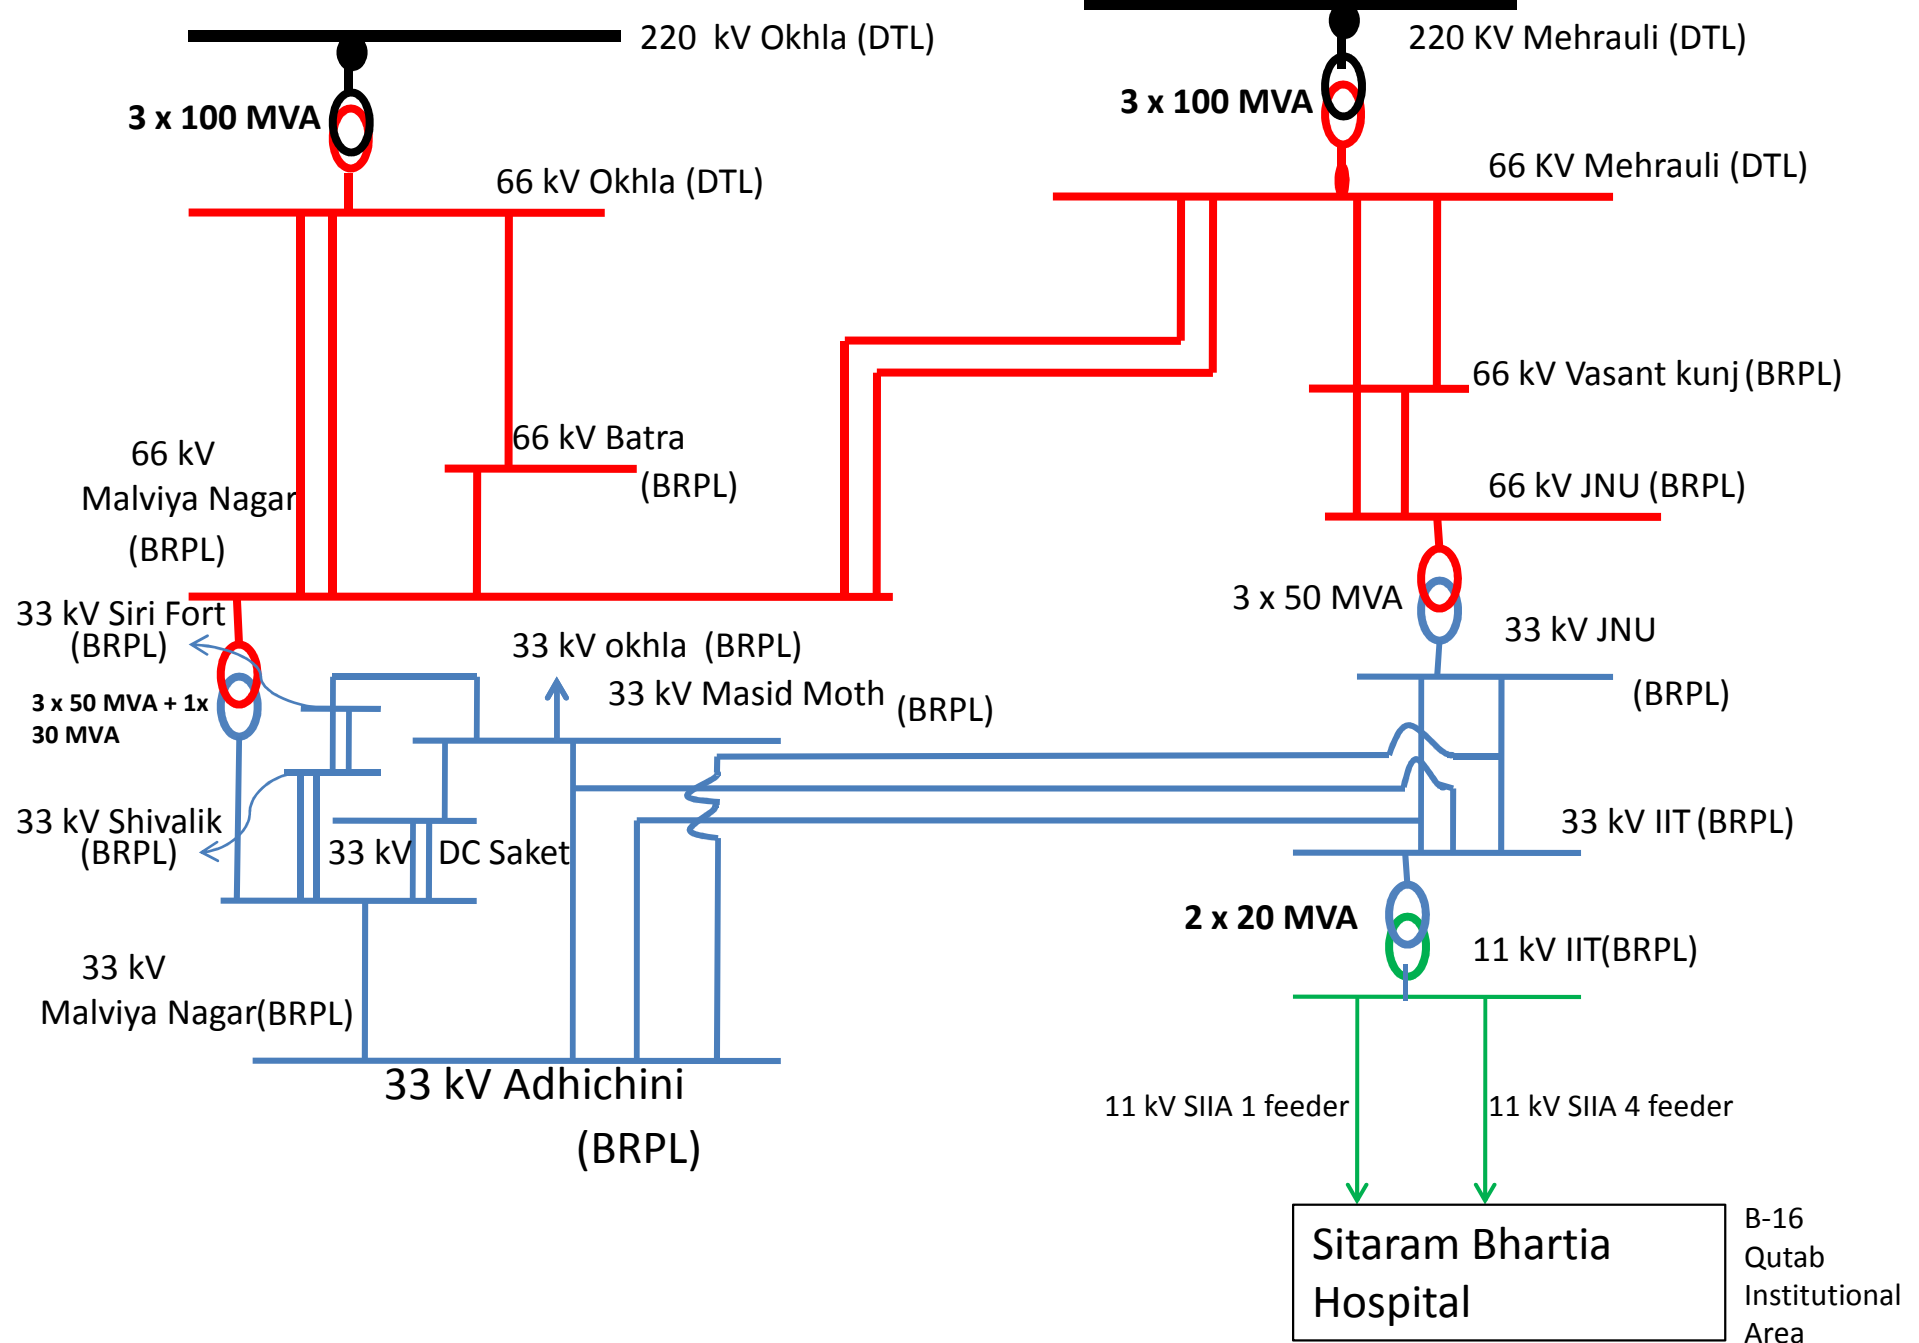

Analysis of interruption of load as per Consumer's Record, BRPL's SCADA data and BRPL's MIS Report

Consumer: Sitaram Bhartiya Institute and Research Centre, B-16 ,Qutab Institutional area , New Delhi-16 (11 kV)

S.no	Interruption details as per Consumer				Outage reported in BRPL SCADA (Yes =1, No=0)	Outage reported in BRPL's MIS report		
	Date	From	To	Duration		Timings	Remarks	Faithful reporting (Yes =1, No=0)
		hh:mm	hh:mm	hh:mm		hhmm - hhmm		
	A	B	C	D	AC	AD	AE	
1	02-06-09	11:45	12:30	00:45	1			0
2	03-06-09	07:10	07:25	00:15	1			0
3		09:45	10:15	00:30	0			0
4	04-06-09	10:45	11:50	01:05	0	1042-1147	Tripping of 100 MVA tranformer at Vasant Kunj	1
5	05-06-09	16:00	16:35	00:35	1	1500-1720	Tripping of 50 MVA transformer at Malviya Nagar	1
6	06-06-09	12:15	13:40	01:25	1	1210-1255	O/L of JNU-Adhchini Ckt	1
7		17:35	18:00	00:25	0			0
8	08-06-09	07:05	07:20	00:15	0			0
9		08:35	09:45	01:10	0			0
10	10-06-09	21:35	22:30	00:55	0			0
11	11-06-09	11:05	11:20	00:15	0			0
12		13:50	14:20	00:30	0			0
13	15-06-09	12:25	12:40	00:15	1			0
14	19-06-09	11:10	12:20	01:10	1	1115-1206	UFR operation Malviya Nagar	1
15	21-06-09	07:45	08:25	00:40	0			0
16	22-06-09	13:20	13:55	00:35	0			0
17		16:45	17:35	00:50	1	1635-1735	Restrict OD at LF	1
18	23-06-09	16:50	18:00	01:10	0	1700-1800	Restrict OD at LF under Okhla	1
19		03:10	03:35	00:25	0			0
20	25-06-09	14:20	15:25	01:05	0	1410-1510	UFR operation	1
21		02:00	02:15	00:15	0			0
22		11:25	12:20	00:55	1			0
23	26-06-09	13:20	14:55	01:35	1	1302-1402	Restrict OD at LF	1
24		16:30	16:40	00:10	0	1625-1725	Restrict OD at LF	1
25		17:35	18:20	00:45	1	1740-1840	Restrict OD at LF	1
26	27-06-09	00:20	01:10	00:50	1	0025-0125	Restrict OD at LF	1
27		12:05	13:20	01:15	1	1205-1305	Restrict OD at LF	1
28	28-06-09	14:15	15:45	01:30	1	1410-1510	Restrict OD at LF	1
29	30-06-09	18:15	24:00:00	05:45	1	1805-2345	Tripping of JNU interconnector	1

Verification of SCADA data w.r.t. Consumer Report			
Summary of interruptions(for interruption time >= 15 minutes)			
	Consumer	BRPL SCADA	Percentage of interruptions captured by SCADA system
No. of interruptions	28	14	50.00

Verification of MIS data w.r.t. Consumer Report			
Summary of interruptions(for interruption time >= 15 minutes)			
	Consumer	BRPL MIS	Percentage of L.S. reported by MIS
No. of interruptions	28	13	46.43
Interruption duration (Hrs)	27:05	19:00	70.15

Note :

- 1 For the purpose of analysis only those interruptions are considered.where the interruption duration is 15 minute or more.
- 2 All such interruptions duration (>=15 Min) are shown in shaded background.
- 3 The following interruptions reported by consumers have not been taken into consideration due to variation in timings reported by consumers vis-a-vis in the energy meters readings supplied by BRPL.

Date	From	To	Duration
20-06-09	07:10	07:40	00:30
	12:25	12:35	00:10
24-06-09	12:20	13:20	01:00

Analysis of interruption of load as per Consumer's Record, and BRPL's SCADA data

Consumer: Sitaram Bhartiya Institute and Research centre, B-16 ,Qutab Institutional area , New Delhi-16 (11 kV)

S.no	Interruption details as per Consumer				Outage timings as per SCADA Data of BRPL													
	Date	From	To	Duration	33/11 kV IIT						33 kV/11 Masjid Moth				33/11 kV Adhichini			
		hh:mm	hh:mm	hh:mm	11 kV SIIA1	11 kV SIIA 4	33/11 kV Trsfrmr-1	33/11 kV Trsfrmr-2	33 kV Masjid Moth- adhichini T-off	33 kV JNU- Adhichini-1 T-off	33 kV JNU- Adhichini-2 T-off	33 kV I/C from Okhla	33 kV I/C from DC Saket	33 kV Adhichini	33 kV Malviyana gar	33 kV Masjid Moth	33 kV JNU	
	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	
1	02-06-09	11:45	12:30	00:45														
2	03-06-09	07:10	07:25	00:15														
3	04-06-09	09:45	10:15	00:30														
4		10:45	11:50	01:05														
5	05-06-09	16:00	16:35	00:35								1607-1847						
6	06-06-09	12:15	13:40	01:25		1219-1336												
7		17:35	18:00	00:25														
8	08-06-09	07:05	07:20	00:15														
9		08:35	09:45	01:10														
10	10-06-09	21:35	22:30	00:55														
11	11-06-09	11:05	11:20	00:15														
12		13:50	14:20	00:30														
13	15-06-09	12:25	12:40	00:15														
14	19-06-09	11:10	12:20	01:10														
15	21-06-09	07:45	08:25	00:40														
16	22-06-09	13:20	13:55	00:35														
17		16:45	17:35	00:50			1630-1727											
18	23-06-09	16:50	18:00	01:10														
19	25-06-09	03:10	03:35	00:25														
20		14:20	15:25	01:05														
21	26-06-09	02:00	02:15	00:15														
22		11:25	12:20	00:55		1120-1213												
23		13:20	14:55	01:35	1321-1524	1319-1524												
24	26-06-09	16:30	16:40	00:10														
25		17:35	18:20	00:45													1741-1836	
26	27-06-09	00:20	01:10	00:50													0017-0102	
27		12:05	13:20	01:15	1204-1315	1204-1315	1203-1314											
28	28-06-09	14:15	15:45	01:30			1414-1514	1414-1540			1412-							
29	30-06-09	18:15	24:00:00	05:45							2048-2346						1816-	

Consumer: Sitaram Bhartiya Institute and Residential centre, B-16 ,Qutab Institutional area , New Delhi-16 (11 kV)

[illegible]

TIME	SUBSTN	BREAKER	Status
03/06/2009 16:29:31	ADCHINI	33 KV JNU BREAKER	CLOSED -COMMAND BMOHAN
03/06/2009 16:29:31	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS BMOHAN
03/06/2009 16:29:33	ADCHINI	33 KV JNU BREAKER	CLOSED
03/06/2009 16:30:24	ADCHINI	33 KV JNU BREAKER	OPEN -COMMAND BMOHAN
03/06/2009 16:30:24	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS BMOHAN
03/06/2009 16:30:45	ADCHINI	33 KV JNU BREAKER	OPEN
03/06/2009 17:26:25	ADCHINI	33 KV JNU BREAKER	CLOSED -COMMAND BMOHAN
03/06/2009 17:26:25	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS BMOHAN
03/06/2009 17:27:25	ADCHINI	33 KV JNU BREAKER	COMMAND FAILURE
03/06/2009 17:29:36	ADCHINI	33 KV JNU BREAKER	CLOSED
03/06/2009 17:29:36	ADCHINI	33 KV JNU BREAKER	CLOSED N
03/06/2009 18:51:58	ADCHINI	33 KV JNU BREAKER	OPEN
04/06/2009 09:24:06	ADCHINI	33 KV JNU BREAKER	CLOSED
13/06/2009 09:32:48	ADCHINI	33 KV JNU BREAKER	OPEN -COMMAND DSAT
13/06/2009 09:32:49	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS DSAT
13/06/2009 09:33:03	ADCHINI	33 KV JNU BREAKER	OPEN
13/06/2009 09:49:08	ADCHINI	33 KV JNU BREAKER	CLOSED -COMMAND DSAT
13/06/2009 09:49:08	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS DSAT
13/06/2009 09:49:10	ADCHINI	33 KV JNU BREAKER	CLOSED
26/06/2009 17:41:18	ADCHINI	33 KV JNU BREAKER	OPEN -COMMAND SANJ
26/06/2009 17:41:18	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 17:41:20	ADCHINI	33 KV JNU BREAKER	OPEN
26/06/2009 18:36:19	ADCHINI	33 KV JNU BREAKER	CLOSED -COMMAND SANJ
26/06/2009 18:36:19	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 18:36:20	ADCHINI	33 KV JNU BREAKER	CLOSED
27/06/2009 00:17:24	ADCHINI	33 KV JNU BREAKER	OPEN
27/06/2009 00:17:24	ADCHINI	33 KV JNU BREAKER	OPEN -COMMAND SANJ
27/06/2009 00:17:24	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS SANJ
27/06/2009 01:02:19	ADCHINI	33 KV JNU BREAKER	CLOSED -COMMAND SANJ
27/06/2009 01:02:19	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS SANJ
27/06/2009 01:02:20	ADCHINI	33 KV JNU BREAKER	CLOSED
30/06/2009 18:16:33	ADCHINI	33 KV JNU BREAKER	OPEN -COMMAND RDS
30/06/2009 18:16:33	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS RDS
30/06/2009 18:16:34	ADCHINI	33 KV JNU BREAKER	OPEN
30/06/2009 18:16:34	ADCHINI	33 KV JNU BREAKER	OPEN N
30/06/2009 18:42:29	ADCHINI	33 KV JNU BREAKER	CLOSED -COMMAND RDS
30/06/2009 18:42:29	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS RDS
30/06/2009 18:42:30	ADCHINI	33 KV JNU BREAKER	CLOSED
30/06/2009 18:51:05	ADCHINI	33 KV JNU BREAKER	SWITCHING WITH BYPASS RDS
30/06/2009 18:51:06	ADCHINI	33 KV JNU BREAKER	OPEN -COMMAND RDS
30/06/2009 18:51:07	ADCHINI	33 KV JNU BREAKER	OPEN

TIME	SUBSTN	BREAKER	Status
06/06/2009 10:54:53	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
06/06/2009 11:12:35	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
26/06/2009 13:21:22	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
26/06/2009 13:21:22	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
26/06/2009 13:21:46	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
26/06/2009 15:24:08	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
27/06/2009 12:04:28	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
27/06/2009 13:15:33	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
29/06/2009 11:06:34	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
29/06/2009 12:19:42	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED

TIME	SUBSTN	BREAKER	Status
06/06/2009 12:19:5	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN -COMMAND BMOHAN
06/06/2009 12:19:5	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:19:5	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN
06/06/2009 12:56:0	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 12:56:0	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:57:0	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 12:57:2	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 12:57:2	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:58:2	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 12:58:3	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 12:58:3	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:59:3	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 13:04:4	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 13:04:4	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 13:05:4	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 13:18:1	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND KKGROV
06/06/2009 13:18:1	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS KKGROV
06/06/2009 13:19:1	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 13:36:3	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND KKGROV
06/06/2009 13:36:3	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS KKGROV
06/06/2009 13:36:3	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
26/06/2009 11:19:5	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN -COMMAND SANJ
26/06/2009 11:19:5	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 11:20:0	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN
26/06/2009 12:13:2	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND SANJ
26/06/2009 12:13:2	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 12:13:3	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED N
26/06/2009 12:13:3	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
26/06/2009 13:19:3	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN -COMMAND SANJ
26/06/2009 13:19:3	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 13:19:4	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN
26/06/2009 13:21:4	IIT	11 KV SIIA S.STN-4 BREAKER	ERR STATUS 00
26/06/2009 14:45:0	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 14:45:0	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND SANJ
26/06/2009 14:46:0	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
26/06/2009 15:24:1	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
27/06/2009 12:04:2	IIT	11 KV SIIA S.STN-4 BREAKER	ERR STATUS 00
27/06/2009 13:15:3	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
29/06/2009 11:06:3	IIT	11 KV SIIA S.STN-4 BREAKER	ERR STATUS 00
29/06/2009 12:19:5	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED

TIME	SUBSTN	BREAKER	Status
07/06/2009 15:12:33	IIT	11 KV LV2 BREAKER	CLOSED
07/06/2009 15:13:04	IIT	11 KV LV2 BREAKER	ERR STATUS 00
07/06/2009 16:03:34	IIT	11 KV LV2 BREAKER	CLOSED
07/06/2009 16:04:05	IIT	11 KV LV2 BREAKER	ERR STATUS 00
07/06/2009 18:40:19	IIT	11 KV LV2 BREAKER	CLOSED
25/06/2009 22:38:06	IIT	11 KV LV2 BREAKER	ERR STATUS 00
27/06/2009 12:03:28	IIT	11 KV LV1 BREAKER	OPEN -COMMAND SANJ
27/06/2009 12:03:28	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS SANJ
27/06/2009 12:03:36	IIT	11 KV LV1 BREAKER	OPEN
27/06/2009 13:14:38	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS SANJ
27/06/2009 13:14:39	IIT	11 KV LV1 BREAKER	CLOSED -COMMAND SANJ
27/06/2009 13:14:45	IIT	11 KV LV1 BREAKER	CLOSED
28/06/2009 14:14:04	IIT	11 KV LV1 BREAKER	OPEN -COMMAND SANJ
28/06/2009 14:14:04	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS SANJ
28/06/2009 14:14:10	IIT	11 KV LV1 BREAKER	OPEN
28/06/2009 14:14:18	IIT	11 KV LV2 BREAKER	OPEN -COMMAND SANJ
28/06/2009 14:14:18	IIT	11 KV LV2 BREAKER	SWITCHING WITH BYPASS SANJ
28/06/2009 14:14:51	IIT	11 KV LV2 BREAKER	OPEN
28/06/2009 15:14:08	IIT	11 KV LV1 BREAKER	CLOSED -COMMAND DSAT
28/06/2009 15:14:08	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS DSAT
28/06/2009 15:14:15	IIT	11 KV LV1 BREAKER	CLOSED
28/06/2009 15:14:21	IIT	11 KV LV2 BREAKER	CLOSED -COMMAND DSAT
28/06/2009 15:14:21	IIT	11 KV LV2 BREAKER	SWITCHING WITH BYPASS DSAT
28/06/2009 15:15:21	IIT	11 KV LV2 BREAKER	COMMAND FAILURE
28/06/2009 15:40:09	IIT	11 KV LV2 BREAKER	ERR STATUS 00

IIT

TIME	SUBSTN	BREAKER	Status
25/06/2009 08:59:19	IIT	33 KV 1 JNU ADHCHINI BREAKER	OPEN
25/06/2009 08:59:19	IIT	33 KV MASJID MOTH TO BREAKER	ERR STATUS 00
28/06/2009 14:12:26	IIT	33 KV 2 JNU ADHCHINI BREAKER	OPEN -COMMAND SANJ
28/06/2009 14:12:26	IIT	33 KV 2 JNU ADHCHINI BREAKER	SWITCHING WITH BYPASS SANJ
28/06/2009 14:13:25	IIT	33 KV 2 JNU ADHCHINI BREAKER	COMMAND FAILURE
30/06/2009 20:48:16	IIT	33 KV 2 JNU ADHCHINI BREAKER	ERR STATUS 00
30/06/2009 23:43:48	IIT	33 KV 2 JNU ADHCHINI BREAKER	OPEN -COMMAND SANJ
30/06/2009 23:43:48	IIT	33 KV 2 JNU ADHCHINI BREAKER	SWITCHING WITH BYPASS SANJ
30/06/2009 23:44:48	IIT	33 KV 2 JNU ADHCHINI BREAKER	COMMAND FAILURE
30/06/2009 23:45:03	IIT	33 KV 2 JNU ADHCHINI BREAKER	CLOSED -COMMAND SANJ
30/06/2009 23:45:03	IIT	33 KV 2 JNU ADHCHINI BREAKER	SWITCHING WITH BYPASS SANJ
30/06/2009 23:46:03	IIT	33 KV 2 JNU ADHCHINI BREAKER	COMMAND FAILURE
30/06/2009 23:46:24	IIT	33 KV 2 JNU ADHCHINI BREAKER	CLOSED

TIME	SUBSTN	BREAKER	Status
07/06/2009 15:12:33	IIT	11 KV LV2 BREAKER	CLOSED
07/06/2009 15:13:04	IIT	11 KV LV2 BREAKER	ERR STATUS 00
07/06/2009 16:03:34	IIT	11 KV LV2 BREAKER	CLOSED
07/06/2009 16:04:05	IIT	11 KV LV2 BREAKER	ERR STATUS 00
07/06/2009 18:40:19	IIT	11 KV LV2 BREAKER	CLOSED
25/06/2009 22:38:06	IIT	11 KV LV2 BREAKER	ERR STATUS 00
27/06/2009 12:03:28	IIT	11 KV LV1 BREAKER	OPEN -COMMAND SANJ
27/06/2009 12:03:28	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS SANJ
27/06/2009 12:03:36	IIT	11 KV LV1 BREAKER	OPEN
27/06/2009 13:14:38	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS SANJ
27/06/2009 13:14:39	IIT	11 KV LV1 BREAKER	CLOSED -COMMAND SANJ
27/06/2009 13:14:45	IIT	11 KV LV1 BREAKER	CLOSED
28/06/2009 14:14:04	IIT	11 KV LV1 BREAKER	OPEN -COMMAND SANJ
28/06/2009 14:14:04	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS SANJ
28/06/2009 14:14:10	IIT	11 KV LV1 BREAKER	OPEN
28/06/2009 14:14:18	IIT	11 KV LV2 BREAKER	OPEN -COMMAND SANJ
28/06/2009 14:14:18	IIT	11 KV LV2 BREAKER	SWITCHING WITH BYPASS SANJ
28/06/2009 14:14:51	IIT	11 KV LV2 BREAKER	OPEN
28/06/2009 15:14:08	IIT	11 KV LV1 BREAKER	CLOSED -COMMAND DSAT
28/06/2009 15:14:08	IIT	11 KV LV1 BREAKER	SWITCHING WITH BYPASS DSAT
28/06/2009 15:14:15	IIT	11 KV LV1 BREAKER	CLOSED
28/06/2009 15:14:21	IIT	11 KV LV2 BREAKER	CLOSED -COMMAND DSAT
28/06/2009 15:14:21	IIT	11 KV LV2 BREAKER	SWITCHING WITH BYPASS DSAT
28/06/2009 15:15:21	IIT	11 KV LV2 BREAKER	COMMAND FAILURE
28/06/2009 15:40:09	IIT	11 KV LV2 BREAKER	ERR STATUS 00

TIME	SUBSTN	BREAKER	Status
06/06/2009 12:19:53	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN -COMMAND BMOHAN
06/06/2009 12:19:53	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:19:54	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN
06/06/2009 12:56:08	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 12:56:08	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:57:08	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 12:57:22	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 12:57:22	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:58:21	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 12:58:35	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 12:58:35	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 12:59:34	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 13:04:42	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND BMOHAN
06/06/2009 13:04:42	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS BMOHAN
06/06/2009 13:05:42	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 13:18:11	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND KKGROV
06/06/2009 13:18:11	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS KKGROV
06/06/2009 13:19:10	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
06/06/2009 13:36:36	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND KKGROV
06/06/2009 13:36:36	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS KKGROV
06/06/2009 13:36:37	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
26/06/2009 11:19:55	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN -COMMAND SANJ
26/06/2009 11:19:55	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 11:20:06	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN
26/06/2009 12:13:20	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND SANJ
26/06/2009 12:13:20	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 12:13:30	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED N
26/06/2009 12:13:31	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
26/06/2009 13:19:32	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN -COMMAND SANJ
26/06/2009 13:19:32	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 13:19:40	IIT	11 KV SIIA S.STN-4 BREAKER	OPEN
26/06/2009 13:21:46	IIT	11 KV SIIA S.STN-4 BREAKER	ERR STATUS 00
26/06/2009 14:45:04	IIT	11 KV SIIA S.STN-4 BREAKER	SWITCHING WITH BYPASS SANJ
26/06/2009 14:45:05	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED -COMMAND SANJ
26/06/2009 14:46:04	IIT	11 KV SIIA S.STN-4 BREAKER	COMMAND FAILURE
26/06/2009 15:24:11	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
27/06/2009 12:04:28	IIT	11 KV SIIA S.STN-4 BREAKER	ERR STATUS 00
27/06/2009 13:15:39	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED
29/06/2009 11:06:34	IIT	11 KV SIIA S.STN-4 BREAKER	ERR STATUS 00
29/06/2009 12:19:50	IIT	11 KV SIIA S.STN-4 BREAKER	CLOSED

TIME	SUBSTN	BREAKER	Status
06/06/2009 10:54:53	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
06/06/2009 11:12:35	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
26/06/2009 13:21:22	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
26/06/2009 13:21:22	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
26/06/2009 13:21:46	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
26/06/2009 15:24:08	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
27/06/2009 12:04:28	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
27/06/2009 13:15:33	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED
29/06/2009 11:06:34	IIT	11 KV SIIA SUB STATIO BREAKER	ERR STATUS 00
29/06/2009 12:19:42	IIT	11 KV SIIA SUB STATIO BREAKER	CLOSED

TIME	SUNSTN	BREAKER	Status
02/06/2009 11:45:10	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
02/06/2009 11:45:11	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
02/06/2009 11:56:31	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
02/06/2009 11:56:31	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
03/06/2009 07:05:57	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
03/06/2009 07:05:57	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
03/06/2009 07:16:48	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
03/06/2009 07:16:48	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
04/06/2009 09:54:03	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
04/06/2009 09:54:03	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
04/06/2009 09:54:03	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
04/06/2009 09:54:03	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
04/06/2009 19:07:10	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
04/06/2009 19:07:11	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
04/06/2009 19:15:52	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
04/06/2009 19:15:52	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
06/06/2009 17:39:38	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
06/06/2009 17:39:38	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
06/06/2009 17:39:38	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
06/06/2009 17:39:38	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
08/06/2009 12:05:55	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
08/06/2009 12:15:14	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 07:37:32	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 07:37:33	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
13/06/2009 07:37:58	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 07:37:58	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
13/06/2009 18:03:55	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
13/06/2009 18:03:55	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
13/06/2009 18:15:31	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 18:15:31	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 18:44:24	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 18:44:24	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
13/06/2009 18:44:38	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
13/06/2009 18:44:39	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
15/06/2009 12:18:40	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
15/06/2009 12:31:03	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
19/06/2009 11:45:14	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
19/06/2009 11:45:14	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
19/06/2009 11:45:14	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
19/06/2009 11:45:14	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
20/06/2009 18:58:00	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
20/06/2009 18:58:00	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN
20/06/2009 19:16:39	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
20/06/2009 19:16:40	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
21/06/2009 00:18:16	JNU	66 KV 1-VASANT KUNJ C BREAKER	CLOSED
21/06/2009 00:18:16	JNU	66 KV 1-VASANT KUNJ C BREAKER	OPEN
21/06/2009 00:18:16	JNU	66 KV 2-VASANT KUNJ C BREAKER	CLOSED
21/06/2009 00:18:16	JNU	66 KV 2-VASANT KUNJ C BREAKER	OPEN

TIME	SUNSTN	BREAKER	Status
02/06/2009 10:42:38	MALV NGR	33 KV ADCHINI BREAKER	OPEN
02/06/2009 10:47:14	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
02/06/2009 12:30:39	MALV NGR	33 KV ADCHINI BREAKER	OPEN
02/06/2009 12:33:47	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
02/06/2009 12:47:26	MALV NGR	33 KV ADCHINI BREAKER	OPEN
02/06/2009 12:49:54	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
04/06/2009 04:09:56	MALV NGR	33 KV ADCHINI BREAKER	OPEN
04/06/2009 04:44:39	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
04/06/2009 04:44:39	MALV NGR	33 KV ADCHINI BREAKER	OPEN
04/06/2009 14:54:09	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
06/06/2009 07:07:05	MALV NGR	33 KV ADCHINI BREAKER	OPEN
06/06/2009 11:01:44	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
06/06/2009 11:31:17	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
06/06/2009 11:31:48	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
06/06/2009 11:35:58	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
06/06/2009 11:37:41	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
06/06/2009 11:41:17	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
06/06/2009 11:41:48	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
06/06/2009 11:42:30	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
06/06/2009 19:36:51	MALV NGR	33 KV ADCHINI BREAKER	OPEN
06/06/2009 19:41:15	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
09/06/2009 00:18:15	MALV NGR	33 KV ADCHINI BREAKER	OPEN
09/06/2009 00:18:30	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
09/06/2009 00:18:46	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
09/06/2009 00:19:17	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
09/06/2009 00:19:17	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
13/06/2009 04:09:18	MALV NGR	33 KV ADCHINI BREAKER	OPEN
13/06/2009 08:32:40	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
13/06/2009 09:35:06	MALV NGR	33 KV ADCHINI BREAKER	OPEN
13/06/2009 09:39:43	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
13/06/2009 09:49:12	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
14/06/2009 01:38:27	MALV NGR	33 KV ADCHINI BREAKER	OPEN
14/06/2009 01:47:59	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
16/06/2009 00:37:46	MALV NGR	33 KV ADCHINI BREAKER	OPEN
16/06/2009 00:37:48	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
16/06/2009 00:38:21	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
16/06/2009 00:38:24	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
16/06/2009 00:38:24	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
19/06/2009 11:21:38	MALV NGR	33 KV ADCHINI BREAKER	OPEN
19/06/2009 11:55:02	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
19/06/2009 12:45:31	MALV NGR	33 KV ADCHINI BREAKER	OPEN
19/06/2009 12:49:39	MALV NGR	33 KV ADCHINI BREAKER	ERR STATUS 00
19/06/2009 13:08:34	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
21/06/2009 14:03:36	MALV NGR	33 KV ADCHINI BREAKER	OPEN
21/06/2009 14:09:45	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
26/06/2009 14:16:07	MALV NGR	33 KV ADCHINI BREAKER	OPEN
26/06/2009 14:21:07	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
26/06/2009 14:59:40	MALV NGR	33 KV ADCHINI BREAKER	OPEN
26/06/2009 15:06:23	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
27/06/2009 13:57:02	MALV NGR	33 KV ADCHINI BREAKER	OPEN
27/06/2009 14:02:30	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
28/06/2009 14:23:58	MALV NGR	33 KV ADCHINI BREAKER	OPEN
28/06/2009 14:32:44	MALV NGR	33 KV ADCHINI BREAKER	CLOSED
30/06/2009 17:02:36	MALV NGR	33 KV ADCHINI BREAKER	OPEN
30/06/2009 17:07:59	MALV NGR	33 KV ADCHINI BREAKER	CLOSED

TIME	SUNSTN	BREAKER	Status
13/06/2009 02:56:09	MALV NGR	66 KV I/C-1MEHRAULI-2BR	OPEN
13/06/2009 02:56:10	MALV NGR	66 KV I/C-2 MEHRAULI- BF	OPEN
13/06/2009 08:32:27	MALV NGR	66 KV I/C-2 MEHRAULI- BF	CLOSED
13/06/2009 08:32:28	MALV NGR	66 KV I/C-1MEHRAULI-2BR	CLOSED
19/06/2009 11:16:33	MALV NGR	66 KV I/C-1MEHRAULI-2BR	OPEN
19/06/2009 11:16:42	MALV NGR	66 KV I/C-2 MEHRAULI- BF	OPEN
19/06/2009 11:54:26	MALV NGR	66 KV I/C-2 MEHRAULI- BF	CLOSED
19/06/2009 11:54:37	MALV NGR	66 KV I/C-1MEHRAULI-2BR	CLOSED
26/06/2009 22:14:40	MALV NGR	66 KV I/C-2 MEHRAULI- BF	OPEN
26/06/2009 22:14:40	MALV NGR	66 KV I/C-2 MEHRAULI- BF	OPEN N
26/06/2009 22:14:43	MALV NGR	66 KV I/C-1MEHRAULI-2BR	OPEN
27/06/2009 00:25:58	MALV NGR	66 KV I/C-2 MEHRAULI- BF	CLOSED
27/06/2009 00:25:58	MALV NGR	66 KV I/C-1MEHRAULI-2BR	CLOSED

TIME	SUNSTN	BREAKER	Status
04/06/2009 00:52:57	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
04/06/2009 00:52:57	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED N
04/06/2009 18:51:53	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
04/06/2009 19:29:58	MSDMOTH	33 KV 220 KV OKHLA BREAKER	CLOSED
04/06/2009 19:32:28	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN N
04/06/2009 19:32:29	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
05/06/2009 08:33:35	MSDMOTH	33 KV 220 KV OKHLA BREAKER	CLOSED
05/06/2009 16:07:49	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
05/06/2009 16:07:49	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
05/06/2009 16:13:04	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
05/06/2009 16:17:38	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
05/06/2009 16:17:38	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
05/06/2009 18:47:46	MSDMOTH	33 KV 220 KV OKHLA BREAKER	CLOSED
05/06/2009 18:54:14	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
05/06/2009 18:59:50	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN N
05/06/2009 18:59:51	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
05/06/2009 18:59:57	MSDMOTH	33 KV 220 KV OKHLA BREAKER	CLOSED
06/06/2009 05:21:37	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
10/06/2009 18:38:56	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
10/06/2009 18:52:14	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN N
10/06/2009 18:53:13	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
12/06/2009 16:04:15	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
12/06/2009 16:08:21	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
12/06/2009 16:08:24	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
12/06/2009 16:08:34	MSDMOTH	33 KV 220 KV OKHLA BREAKER	CLOSED
13/06/2009 11:46:05	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
13/06/2009 15:26:24	MSDMOTH	33 KV 220 KV OKHLA BREAKER	ERR STATUS 00
13/06/2009 15:26:25	MSDMOTH	33 KV ADCHINI BREAKER	ERR STATUS 00
17/06/2009 14:56:19	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
17/06/2009 14:58:02	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN N
17/06/2009 14:58:03	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
19/06/2009 06:34:51	MSDMOTH	33 KV 220 KV OKHLA BREAKER	OPEN
19/06/2009 06:51:52	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
19/06/2009 06:54:40	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
19/06/2009 06:57:31	MSDMOTH	33 KV 220 KV OKHLA BREAKER	CLOSED
19/06/2009 16:16:44	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
20/06/2009 13:01:14	MSDMOTH	33 KV 220 KV OKHLA BREAKER	ERR STATUS 00
20/06/2009 13:01:14	MSDMOTH	33 KV ADCHINI BREAKER	ERR STATUS 00
25/06/2009 14:56:20	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN
28/06/2009 06:46:14	MSDMOTH	33 KV SIRIFORT BREAKER	CLOSED
28/06/2009 17:48:23	MSDMOTH	33 KV SIRIFORT BREAKER	OPEN

Sita Ram Bhatia Inst. and Res. Centre
B-16, Qutab Inst. Area. N. Delhi - 16

Subject: Details of load shedding/power backup utilized in the month of June 2009

Approx. Load of Society in kW/Amp.

KRN No.

Approx. Load met by generator 471.00 KVA

CRN No. 2551131584

CA No.

S.No.	Date	Time of Switch on of Generator / back up	Time of Switch off of Generator / back up	Duration of non-availability of power	Remarks
1.	2. June 09	11:45 am	12:30 pm	.45 Hrs.	
2.	3. June 09	07:10 am	07:25 am	.15 Hrs.	
3.	4. June 09	9:45 am	10:15 am	.30 Hrs.	
4.	4 June 09	10:45 am	11:50 am	1.05 Hrs.	
5.	5 June 09	4:00 pm	4:35 pm	.35 Hrs.	
6.	6 June 09	12:15 pm	01:40 pm	1.25 Hrs.	
7.	6 June 09	05:35 pm	06:00 pm	.25 Hrs.	
8.	8 June 09	07:05 am	07:20 am	.15 Hrs.	
9.	8 June 09	08:35 am	09:45 am	1.10 Hrs.	
10.	10 June 09	09:35 pm	10:30 pm	.55 Hrs.	
11.	11 June 09	11:05 am	11:20 am	.15 Hrs.	
12.	11 June 09	01:50 pm	2:20 pm	.30 Hrs.	
13.	15 June 09	12:25 pm	12:40 pm	.15 Hrs.	
14.	19 June 09	11:10 am	12:20 am	1.10 Hrs.	
15.	20 June 09	07:10 am	07:40 am	.30 Hrs.	
16.	20 June 09	12:25 pm	12:35 pm	.10 Hrs.	
17.	21 June 09	07:45 am	08:25 am	.40 Hrs.	
18.	22 June 09	1:20 pm	01:55 pm	.35 Hrs.	
19.	22 June 09	4:45 pm	05:35 pm	.50 Hrs.	
20.	23 June 09	4:50 pm	06:00 pm	1.10 Hrs.	
21.	24 June 09	12:20 pm	01:20 pm	1.00 Hrs.	
22.	25 June 09	03:10 am	03:35 pm	.25 Hrs.	
23.	25 June 09	02:20 pm	02:25 pm	1.05 Hrs.	
24.	26 June 09	02:05 am	02:15 am	.15 Hrs.	
25.	26 June 09	11:25 am	12:20 pm	.55 Hrs.	
26.	26 June 09	01:20 pm	02:55 pm	1.35 Hrs.	
27.	26 June 09	04:30 pm	04:40 pm	.10 Hrs.	
28.	26 June 09	05:35 pm	06:20 pm	.45 Hrs.	
29.	27 June 09	12:20 am	01:10 am	.50 Hrs.	
30.	27 June 09	12:05 pm	01:20 pm	1.15 Hrs.	
31.	28 June 09	02:15 pm	03:45 pm	1.30 Hrs.	

Name of Society/Organization

Name and signature of representative

Address



दिल्ली विद्युत विनियामक आयोग
Delhi Electricity Regulatory Commission

(A Statutory Body of Govt. of NCT of Delhi)

Viniyamak Bhawan, C-Block, Shivalik,

Malviya Nagar, New Delhi-110017

Phone: 26673610, 26673605 Fax.: 26673608

Website: www.derc.gov.in

F.17(47)/Engg./DERC/2009-10/2147/

15.10.2009

To

Sital Ram Bhartiya Institute
and Research Centre (Hospital)
Outub Institutional Area
New Delhi -16


Subject: Details of load shedding/power backup utilized in the month of June 2009

Sir

It has come to notice of the Commission that unprecedented load shedding was carried out in areas at Delhi in the month of June 2009. In this regard, the Commission is investigating the matter.

In order to ascertain the quantum of the total load shedding, you are requested to furnish the details of the load shedding/operation of DG set in enclosed format in your society/organization.

Yours faithfully,

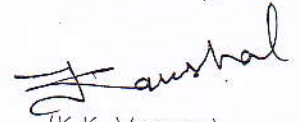

(K.K. Verma)

Jt. Director (Engg.)

9868243560

Encl: as above

9/c